

EAST GLENVILLE FIRE DISTRICT

433 SARATOGA ROAD GLENVILLE, NY 12302

SO.134252

3/17/2008

Quote Rev:92 Drawing Rev:2



1500 GPM HALE QMAX PUMP
780 GALLON WATER TANK


HOSE LOAD:
NFPA COMPLIANT

| COMPT. | OPENING | INTERIOR DIMENSION | |
|--------|---------|----------------------------|-----------------------|
| L1 | 40W 59H | 42W 3H 12D 42W 56H 26D | UPPER LOWER |
| R1 | 40W 59H | 42W 25H 12D 42W 30H 26D | UPPER LOWER |
| L2 | 54W 25H | 56W 3H 12D 56W 22H 26D | UPPER LOWER |
| R2 | 54W 25H | 56W 25H 12D | UPPER |
| L3 | 54W 59H | 42W 3H 26D 14W 56H 24D | UPPER REAR |
| R3 | 54W 59H | 42W 25H 12D 42W 30H 26D | FRNT UPPER REAR |
| L2 | 54W 25H | 14W 25H 10D 56W 30H 24D | BACK UPPER REAR |
| B1 | 36W 25H | 56W 3H 12D 56W 22H 26D | UPPER LOWER |
| B1 | 36W 53H | 36W 53H | 26D |

This print is the property of Emergency One, Inc. and is loaned to you subject to return on demand, unless otherwise agreed to in writing by Emergency One, Inc. Its contents are confidential and must not be copied or submitted to third parties for use or examination.

THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.

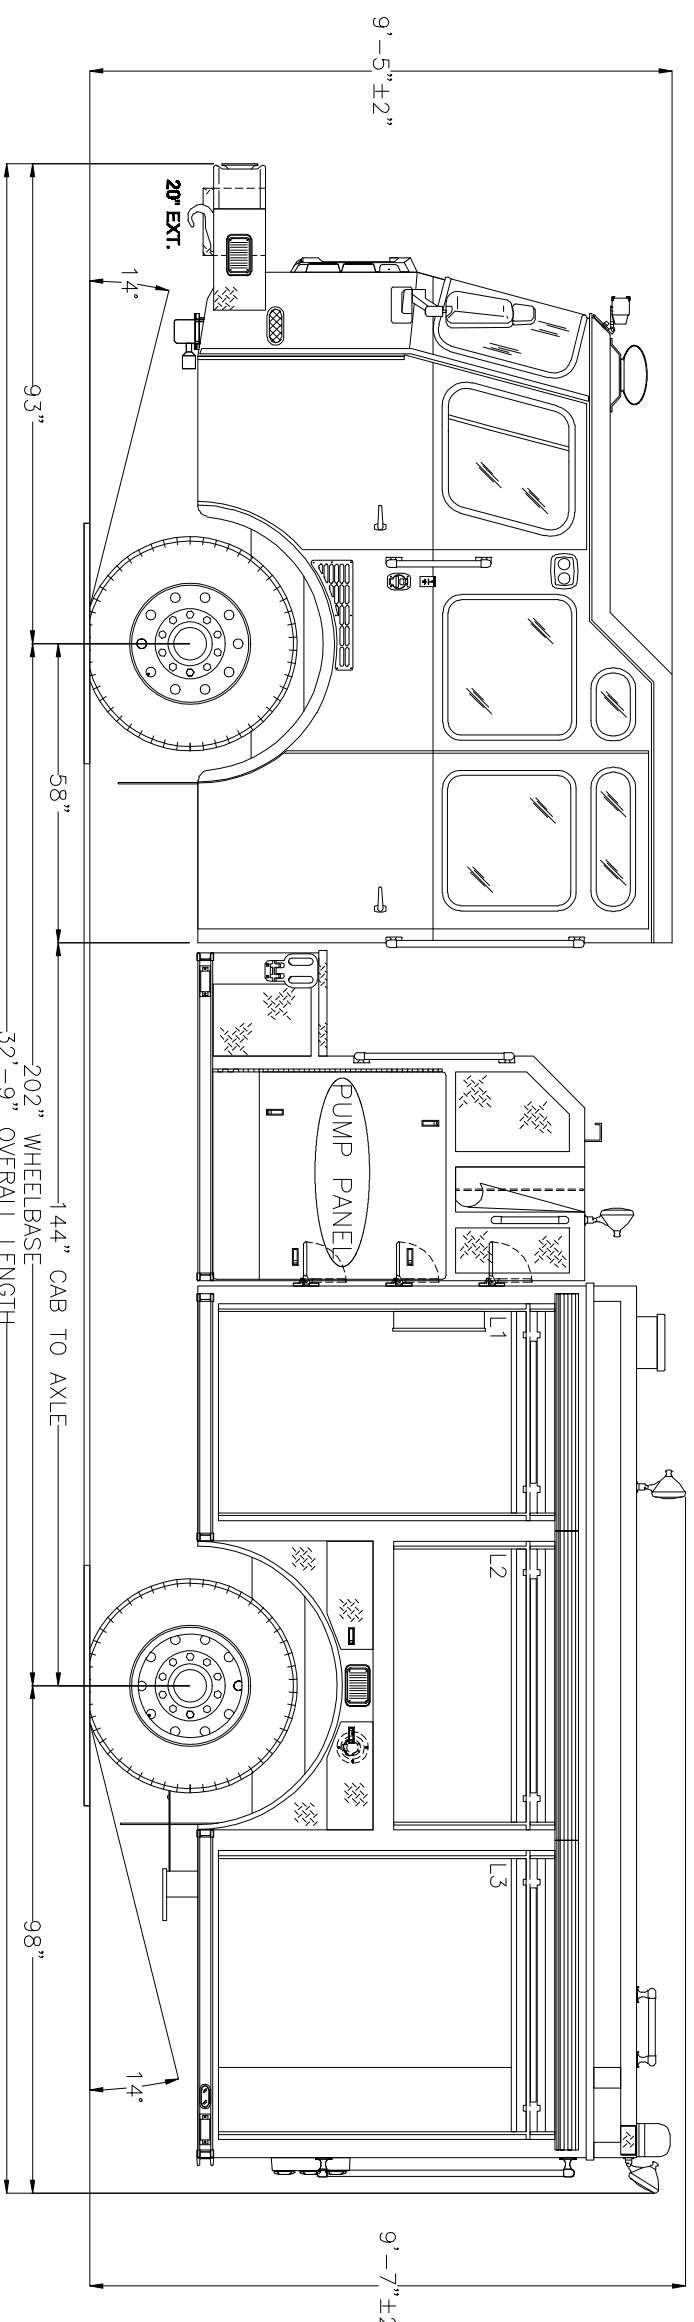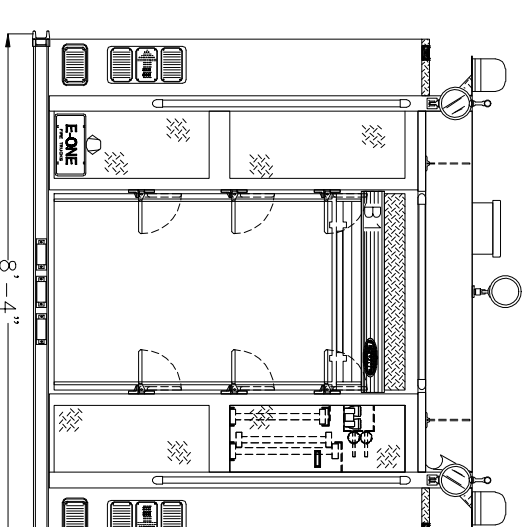

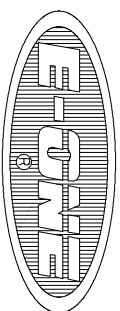

EAST GLENVILLE FIRE DISTRICT
433 SARATOGA ROAD
GLENVILLE, NY 12302

SO.134252

3/17/2008

Quote Rev:92 Drawing Rev:2

